

Test Report



Report No. A225020563920102

Page 1 of 5

Company Name SHENZHEN WELLAUTO TECHNOLOGY CO., LTD
Shown on Report
Address ROOM 402 & 405, BUILDING C, FENDA HIGH-TECH PARK, SANWEI COMMUNITY, HANGCHENG STREET, BAO'AN DISTRICT, SHENZHEN

The following sample(s) and sample information was/were submitted and identified by/on the behalf of the client

Sample Name IP67 Fieldbus Series Products
Sample Received Date Apr. 2, 2025
Testing Period Apr. 2, 2025-Apr. 8, 2025

Test Requested

No.	Test Item
1	Mechanical shock test

Test Result(s): Please see the following pages.

Approved by Tim Sun

Date Apr. 8, 2025

Tim Sun
Approved Signatory

Centre Testing International Group Co., Ltd.

No. R3BDE2AC8A
Hongwei Industrial Zone, Bao'an 70 District, Shenzhen, Guangdong, China

Test Report


Report No. A225020563920102

Page 2 of 5

Tested Sample(s)

Sample No.	Sample Name	Type	Part Number	Quantity
A2250205639201002	IP67 Fieldbus Series Products	IP67 系列 AUIO16DIOP-TE	IP67 系列 AUIO16DIOP-TE	1pc
A2250205639201003	IP67 Fieldbus Series Products	IP67 系列 AUIO16DIOP-T	IP67 系列 AUIO16DIOP-T	1pc
A2250205639201004	IP67 Fieldbus Series Products	IP67 系列 AUIO8AIIH-BUS	IP67 系列 AUIO8AIIH-BUS	1pc
A2250205639201005	IP67 Fieldbus Series Products	IP67 系列 AUPN16DIOP	IP67 系列 AUPN16DIOP	1pc
A2250205639201006	IP67 Fieldbus Series Products	IP67 系列 AUEC8A0B	IP67 系列 AUEC8A0B	1pc
A2250205639201007	IP67 Fieldbus Series Products	IP67 系列 AUIO16DION-TE	IP67 系列 AUIO16DION-TE	1pc
A2250205639201008	IP67 Fieldbus Series Products	IP67 系列 AUIO16DION-T	IP67 系列 AUIO16DION-T	1pc
A2250205639201009	IP67 Fieldbus Series Products	IP67 系列 AUBO8AOH	IP67 系列 AUBO8AOH	1pc

Sample Photo(s)

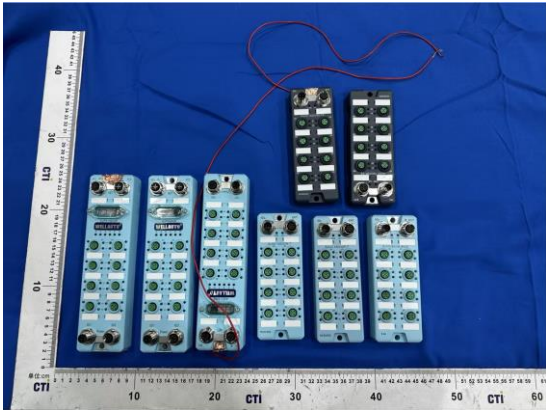

Test Report

Report No. A225020563920102

Page 3 of 5

Test Item: Mechanical shock test**1. Test Equipment**

Equipment Name	Model
Vibration Tester	ET-40LS3-370

2. Environmental Conditions

Temperature: 26.4°C; Humidity: 46 %RH

3. Test Standard: GB/T 2423.5-2019**4. Test Condition**

Wave form	Acceleration(g)	Pulse duration (ms)	Test direction	Shock times
half sine	20	13	±Z	3time/direction

5. Test Result(s)

Sample No.	Judgment basis	Test result	Conclusion
A2250205639201002~009	There was no mechanical damage to the appearance of the sample after the test.	After testing, visually check the appearance of the sample without mechanical damage.	Pass
Remarks: The judgment basis is provided by the customer.			

Test Photo(s)


±Z

Test Report


Report No. A225020563920102

Page 4 of 5

Test Curve

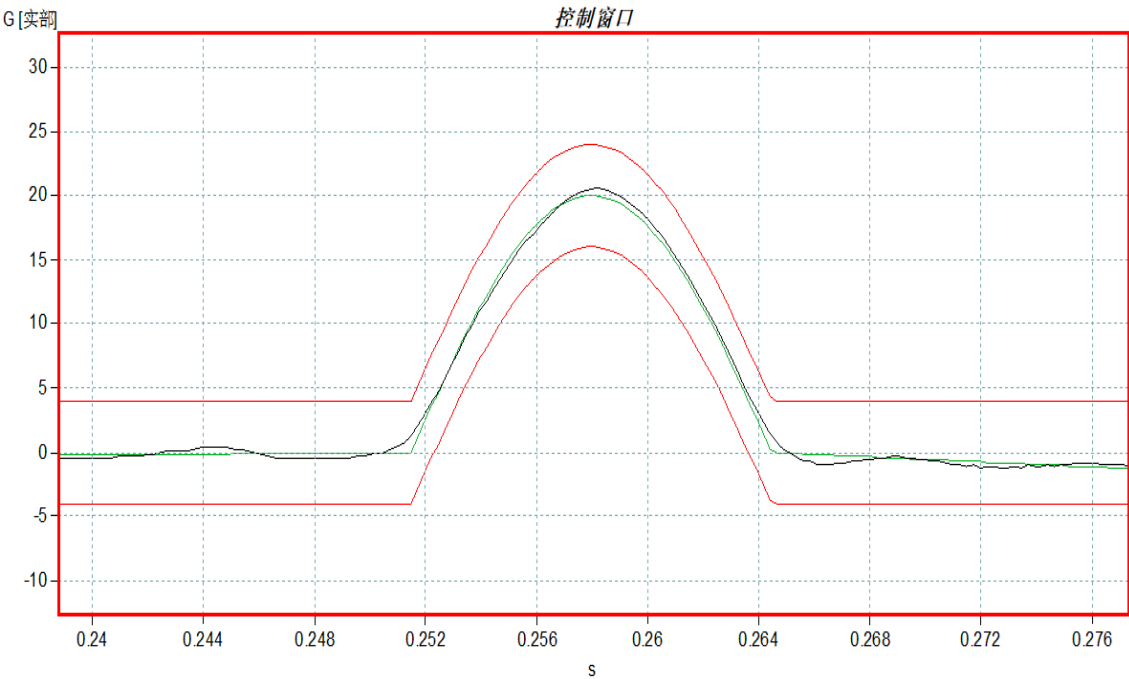

+Z

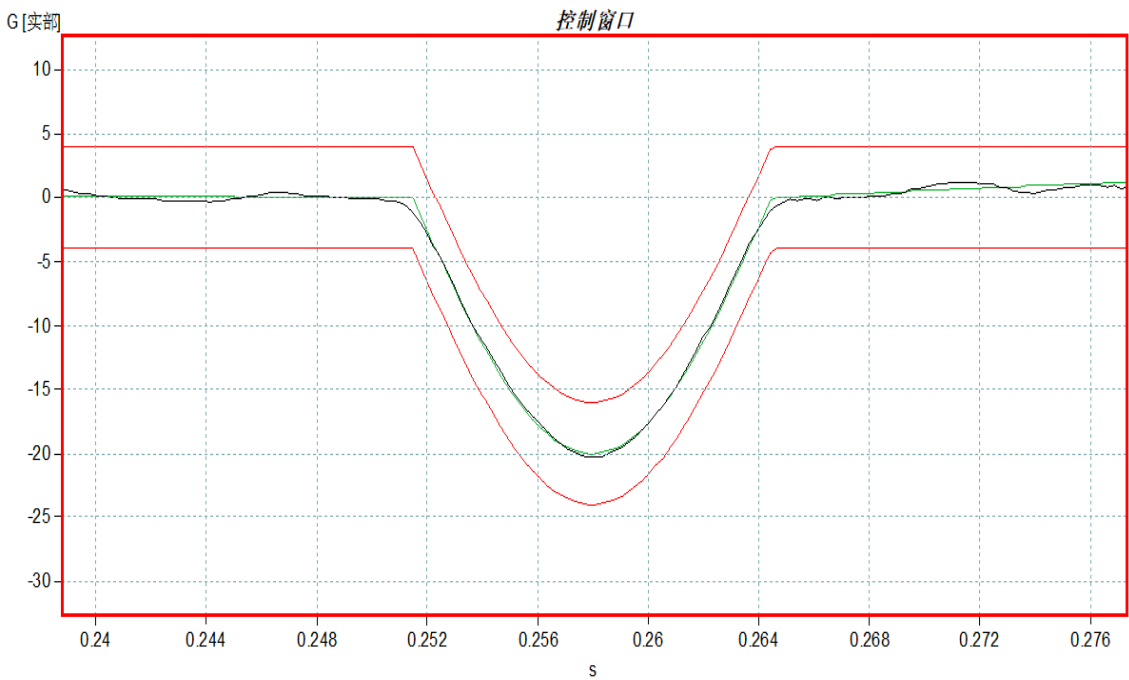

-Z

Test Report

Report No. A225020563920102

Page 5 of 5

Remark: The testing data and result(s) in this report is(are) just for scientific research, education, internal quality control and product development etc.

Statement:

- 1.This report is considered invalid without approved signature, special seal and the seal on the perforation;
- 2.Company Name and Address shown on Report, the sample(s) and sample Information was/were provided by the applicant who should be responsible for the authenticity which CTI hasn't verified;
- 3.The result(s) shown in this report refer(s) only to the sample(s) tested;
- 4.Without written approval of CTI, this report can't be reproduced except in full;
- 5.In case of any discrepancy between the English version and Chinese version of the testing reports(if generated), the Chinese version shall prevail.

*** End of Report ***

